



Benchmarking of Wind Turbine Wake Models in Large Offshore Windfarms

Gaumond, M.; Réthoré, Pierre-Elouan; Bechmann, Andreas; Ott, Søren; Larsen, Gunner Chr.; Pena Diaz, Alfredo; Hansen, Kurt Schaldemose

Publication date:
2012

Document Version
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

Citation (APA):
Gaumond, M., Réthoré, P-E., Bechmann, A., Ott, S., Larsen, G. C., Pena Diaz, A., & Hansen, K. S. (2012). *Benchmarking of Wind Turbine Wake Models in Large Offshore Windfarms*. Poster session presented at The science of Making Torque from Wind 2012, Oldenburg, Germany.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Benchmarking of Wind Turbine Wake Models in Large Offshore Windfarms

M. Gaumond¹, P.-E. Réthoré^{1(*)}, A. Bechmann¹, S. Ott¹,
G. C. Larsen¹, A. Peña¹ and K. S. Hansen²

¹DTU Wind Energy, Risø Campus, Roskilde, Denmark ²Department of Mechanical Engineering, DTU, Lyngby, Denmark

This work was funded by the NSERC, the FQRNT, the EUDP-WakeBench and FP7 EERA-DTOC projects.

Abstract

Quantifying accurately wind turbine wakes is a key aspect of wind farm economics in large wind farms. This research compares three engineering wake models with power production data from the Horns Rev and Lillgrund offshore wind farms. Single and multiple wake cases are investigated to verify the performance of the models in different conditions. The simulations reveal that the three wake models have similar behaviours for both wind farms although the turbine spacing and the turbulence intensity are different. The results prove the robustness of the models to provide accurate power predictions when the simulations are averaged over wind direction sectors of 30°. However, all models significantly underpredict the power production of a single row of wind turbines using narrow sectors of 3° or 5°. This discrepancy is discussed and justified by the wind direction uncertainty included in the datasets.

Site and measurements

Fig. 1 shows the layout of the Horns Rev and Lillgrund offshore wind farms. The measured turbulence intensity for westerly winds at Horns Rev is 7% and the turbine spacing is 7 rotor diameters (D). At Lillgrund, the turbulence intensity for southwesterly winds is 5.6% and the turbine spacing is 4.3 D .

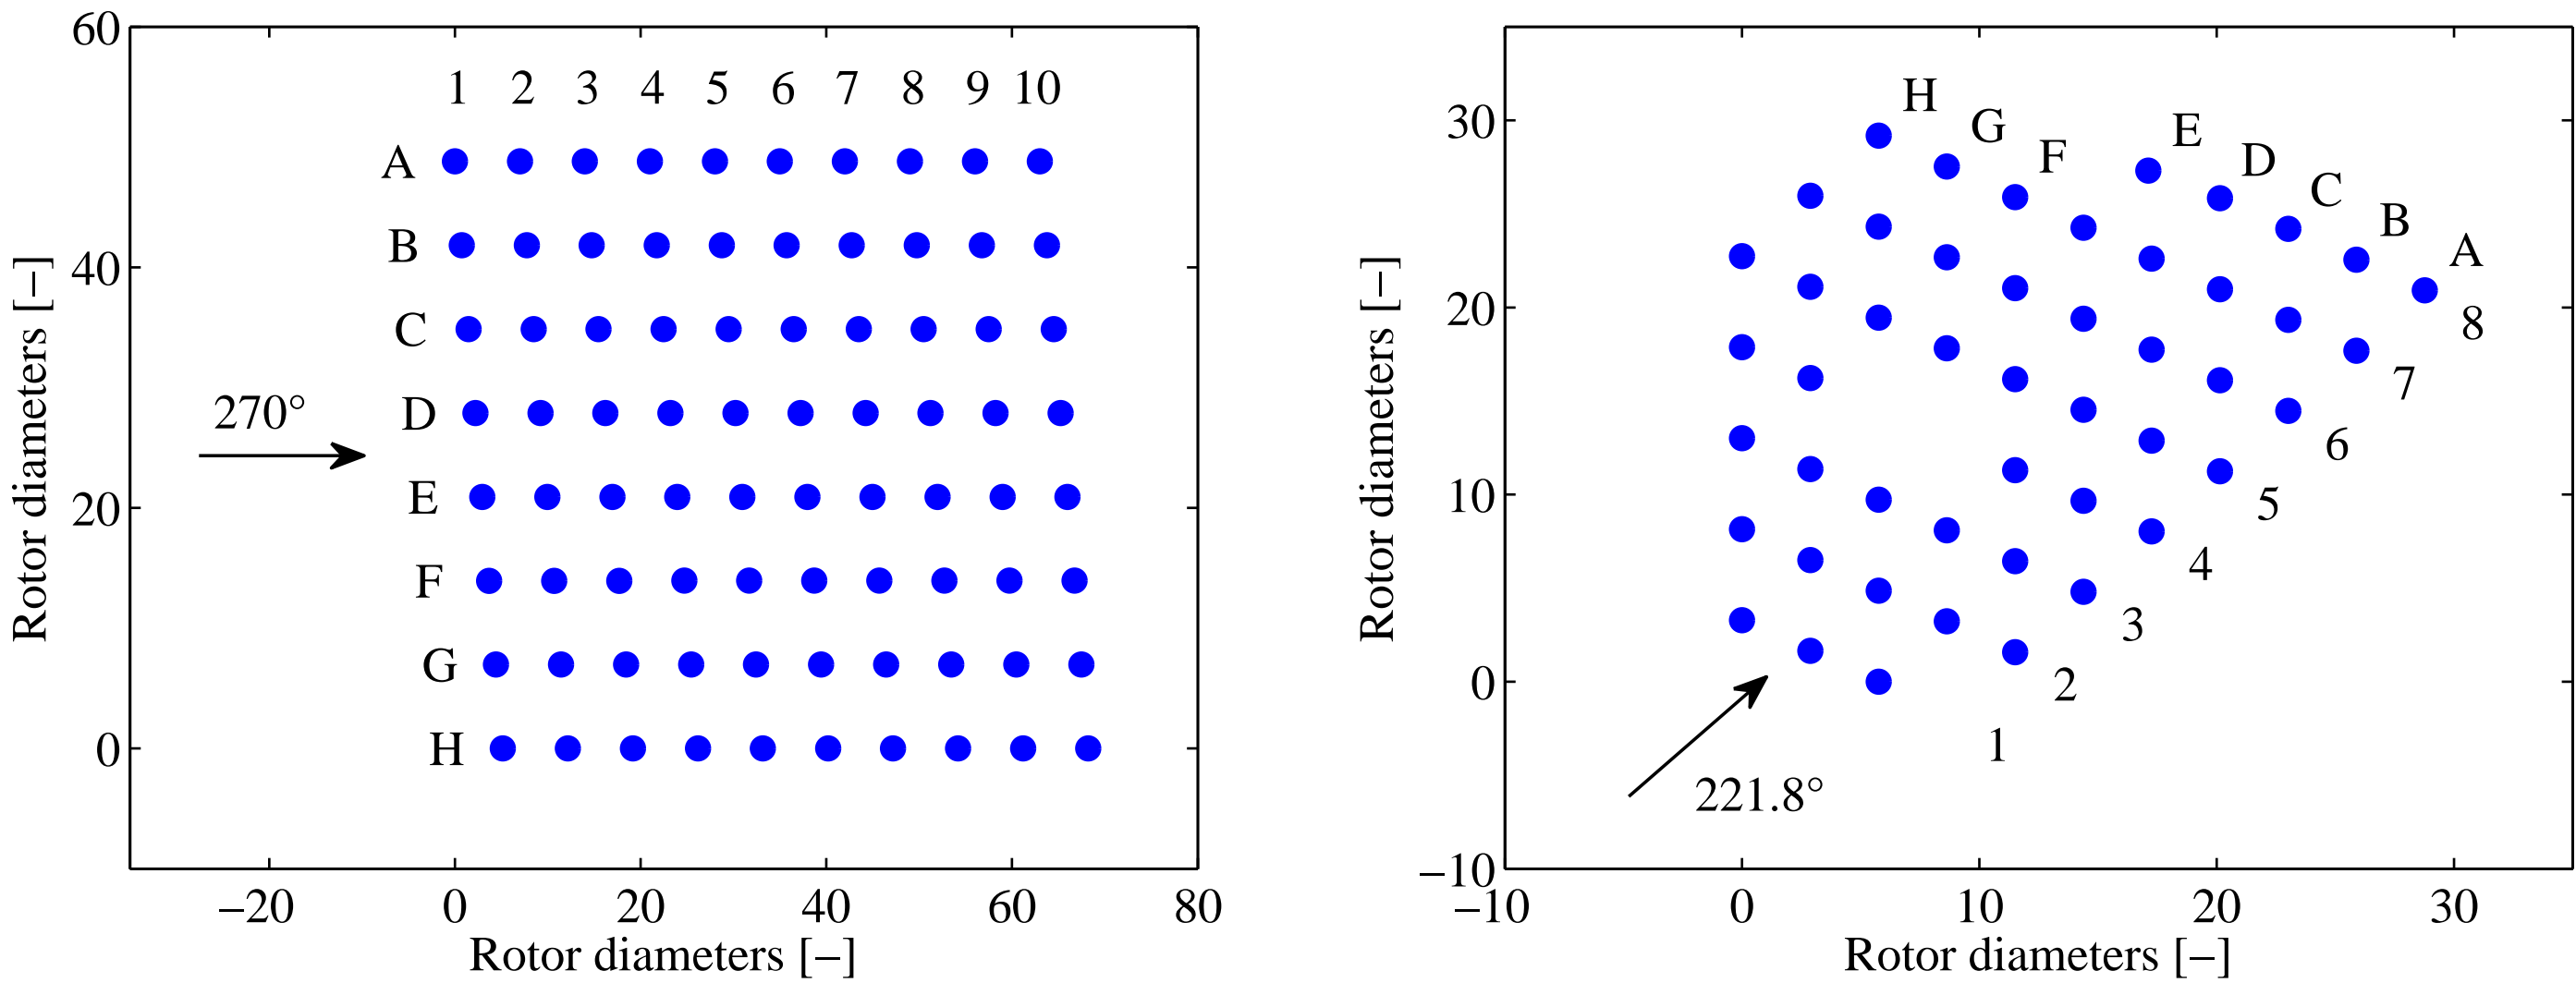


Figure 1: Layout of the Horns Rev wind farm (left) and Lillgrund wind farm (right)

Wake models

The Jensen model, the Larsen model and Fuga are cluster wake models that assume neutral atmospheric stability. Here, the Jensen model refers to the cluster wake model suggested by Katic *et al.* [2] using the single wake model of Jensen [1]. The Larsen model corresponds to the most recent update of the model from Larsen [3] where the velocity recovery and wake expansion are controlled by the turbine’s thrust coefficient and the ambient turbulence intensity. Fuga is a linear flow solver based on the steady-state RANS equations. No numerical grid is required by the solver, which eliminates user dependency and numerical diffusion. The complete description of Fuga and its evaluation with wind farm datasets can be found in Ott *et al.* [4]. In this study, Fuga version 2.0.0.28 is used with a roughness length of 0.0001 m and a boundary layer height of 500 m.

Interaction between two turbines

Except for the Larsen model at Lillgrund, Fig. 2 shows that the numerical simulations agree very well with power production data for the two single wake flow cases investigated. Since the wake radius in the Larsen model was calibrated from measurements at 9.6 D [3], the overprediction of this model at Lillgrund might be caused by the short turbine spacing.

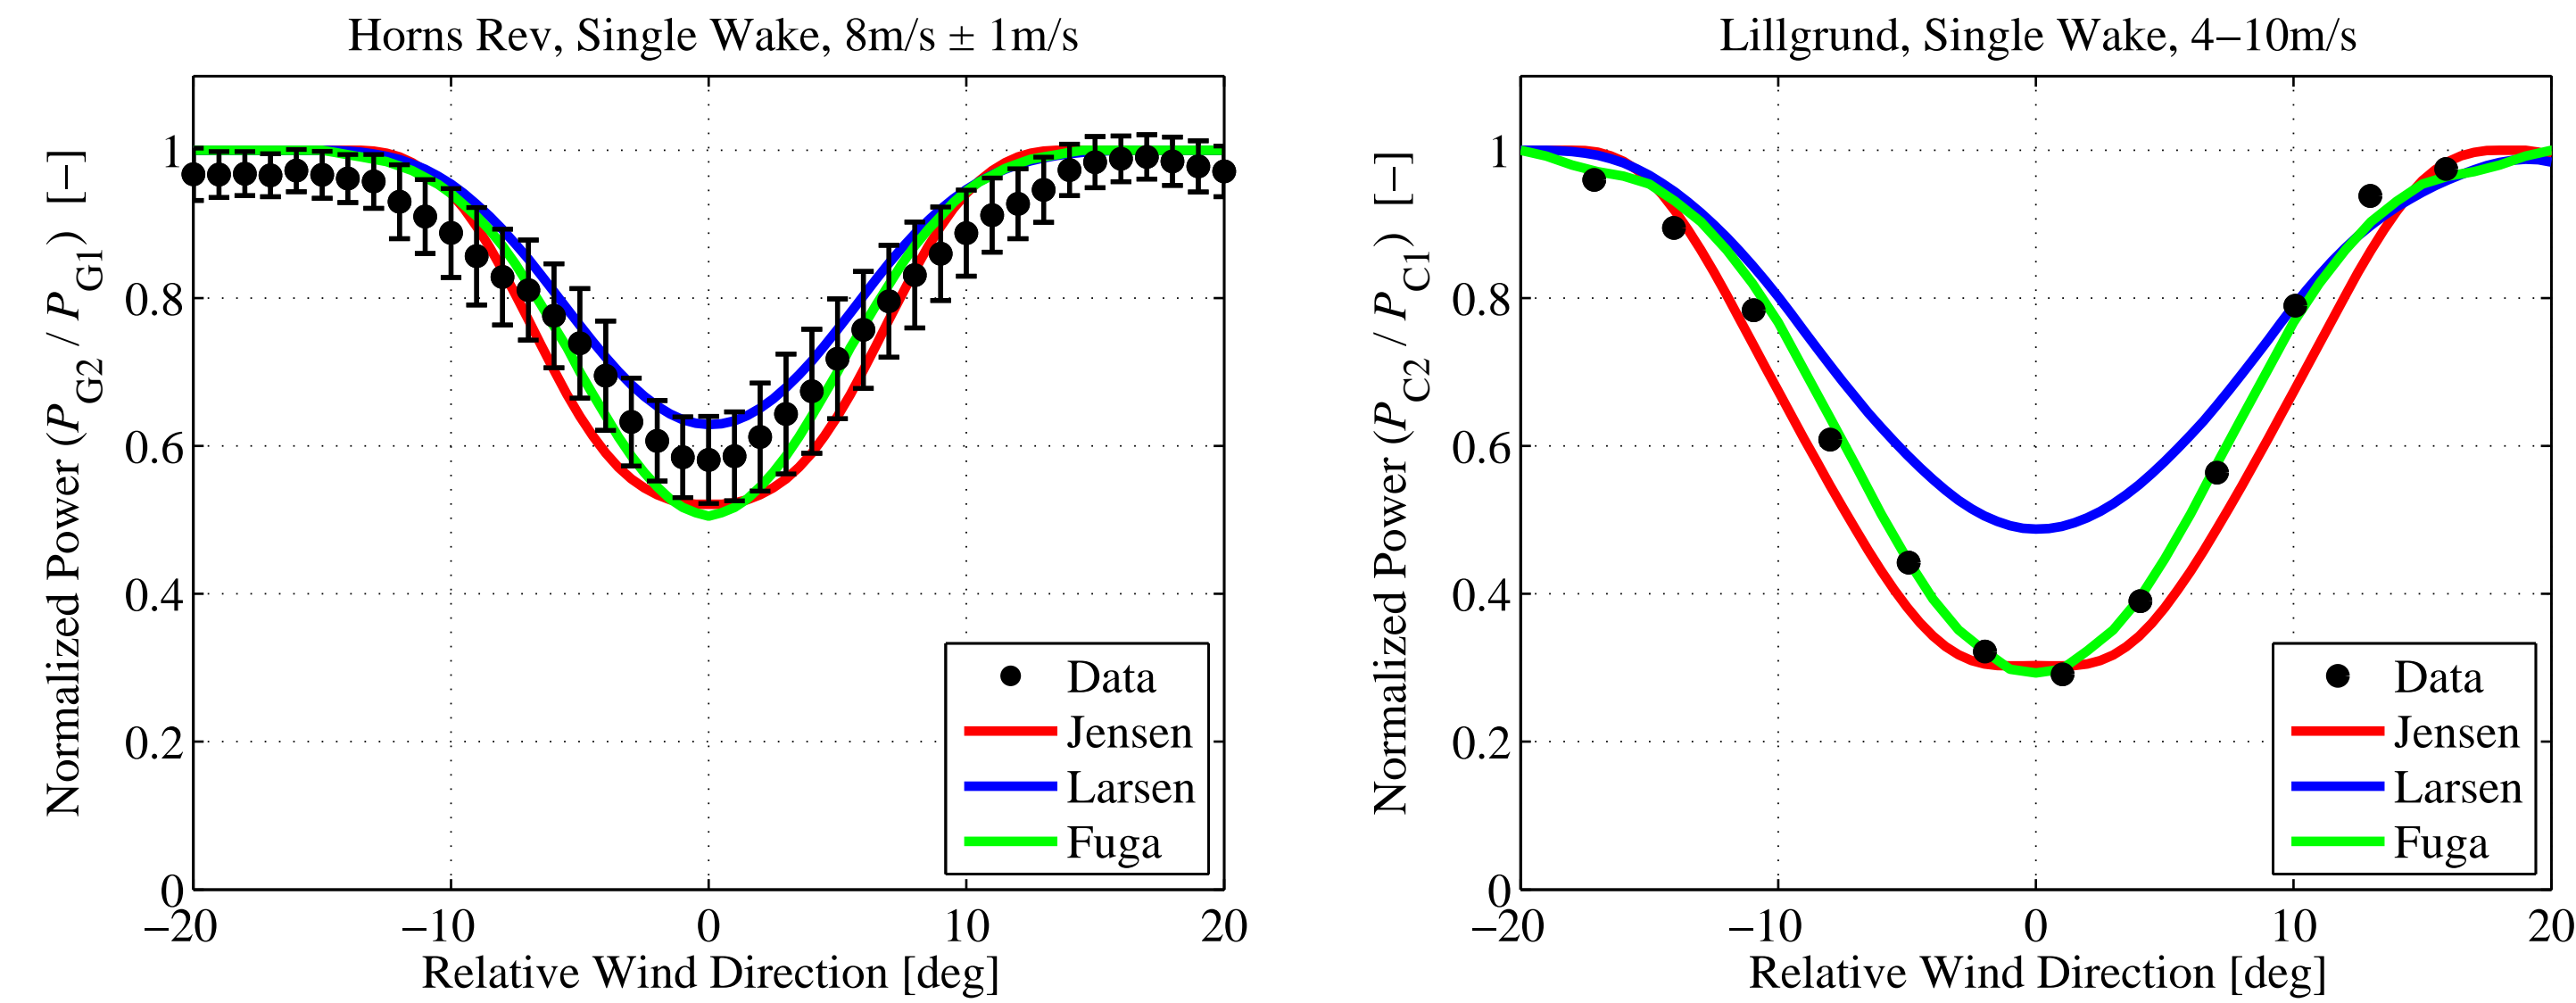


Figure 2: Normalized power of the second turbine in row G at Horns Rev (left) and in row C at Lillgrund (right)

References

[1] N. O. Jensen. A note on wind generator interaction. Technical Report Risø-M-2411, Risø National Laboratory, Roskilde, 1983.
[2] I. Katic, J. Højstrup, and N. O. Jensen. A simple model for cluster efficiency. In *Proceedings of the EWEA Conference*, pages 407–410, Rome, 1986.
[3] G. C. Larsen. A simple stationary semi-analytical wake model. Technical Report Risø-R-1713(EN), Risø National Laboratory, Roskilde, 2009.
[4] S. Ott, J. Berg, and M. Nielsen. Linearised CFD models for wakes. Technical Report Risø-R-1772(EN), Risø National Laboratory, Roskilde, 2011.

Multiple wake cases along a row of wind turbines

Fig. 3 and 4 show that the models underpredict the power production of the narrow sectors ($\pm 2.5^\circ$ and $\pm 1.5^\circ$), while obtaining good to excellent accuracy for $\pm 15^\circ$. Hence, there is a clear correlation between the accuracy of the power predictions and the span of the averaging sector.

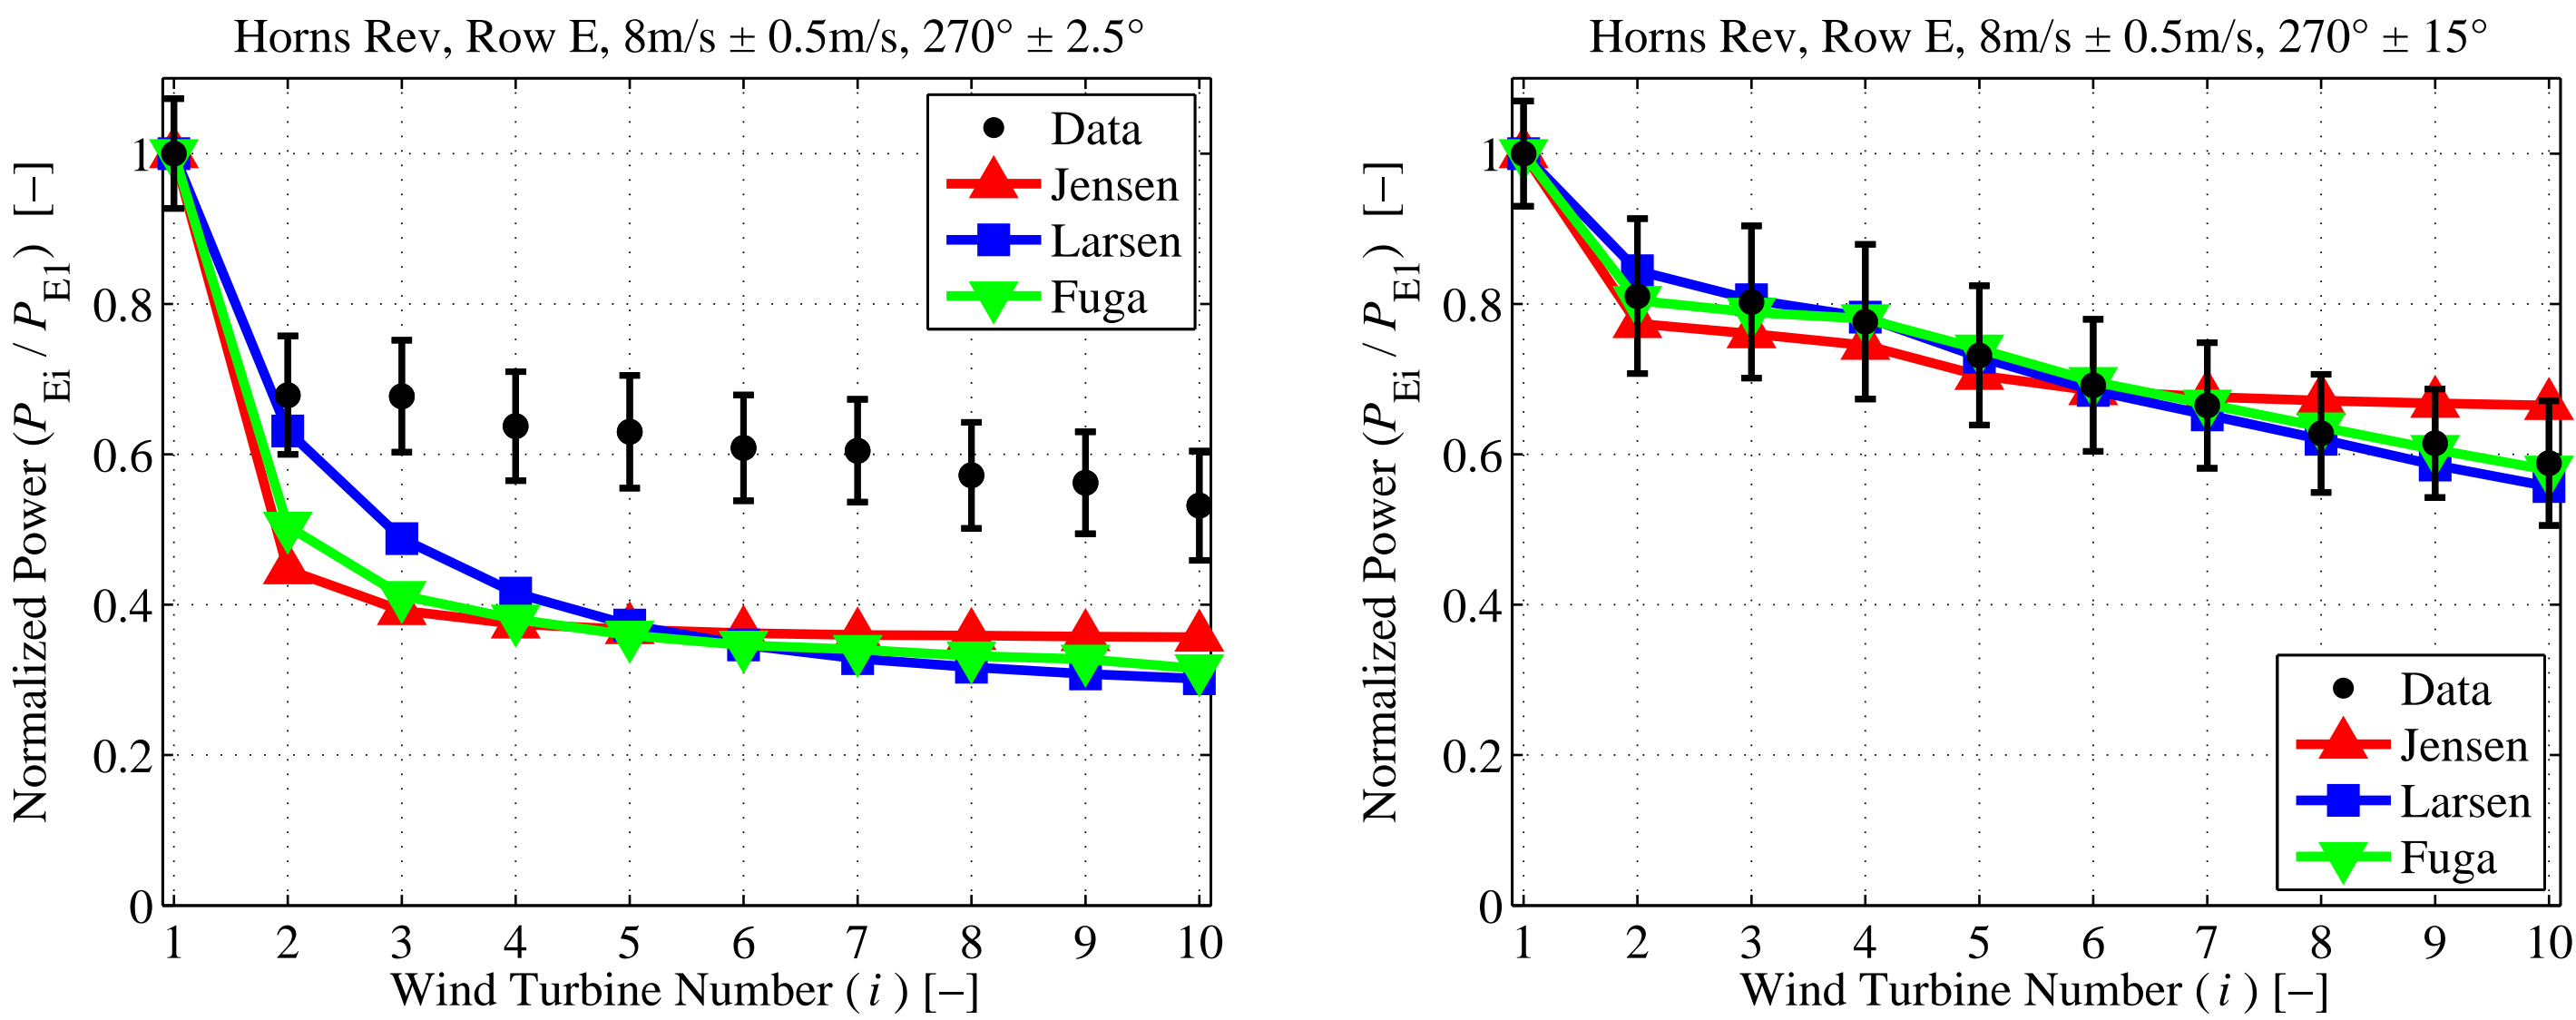


Figure 3: Normalized power in row E at Horns Rev for the wind direction sector 270° $\pm 2.5^\circ$ (left) and $\pm 15^\circ$ (right).

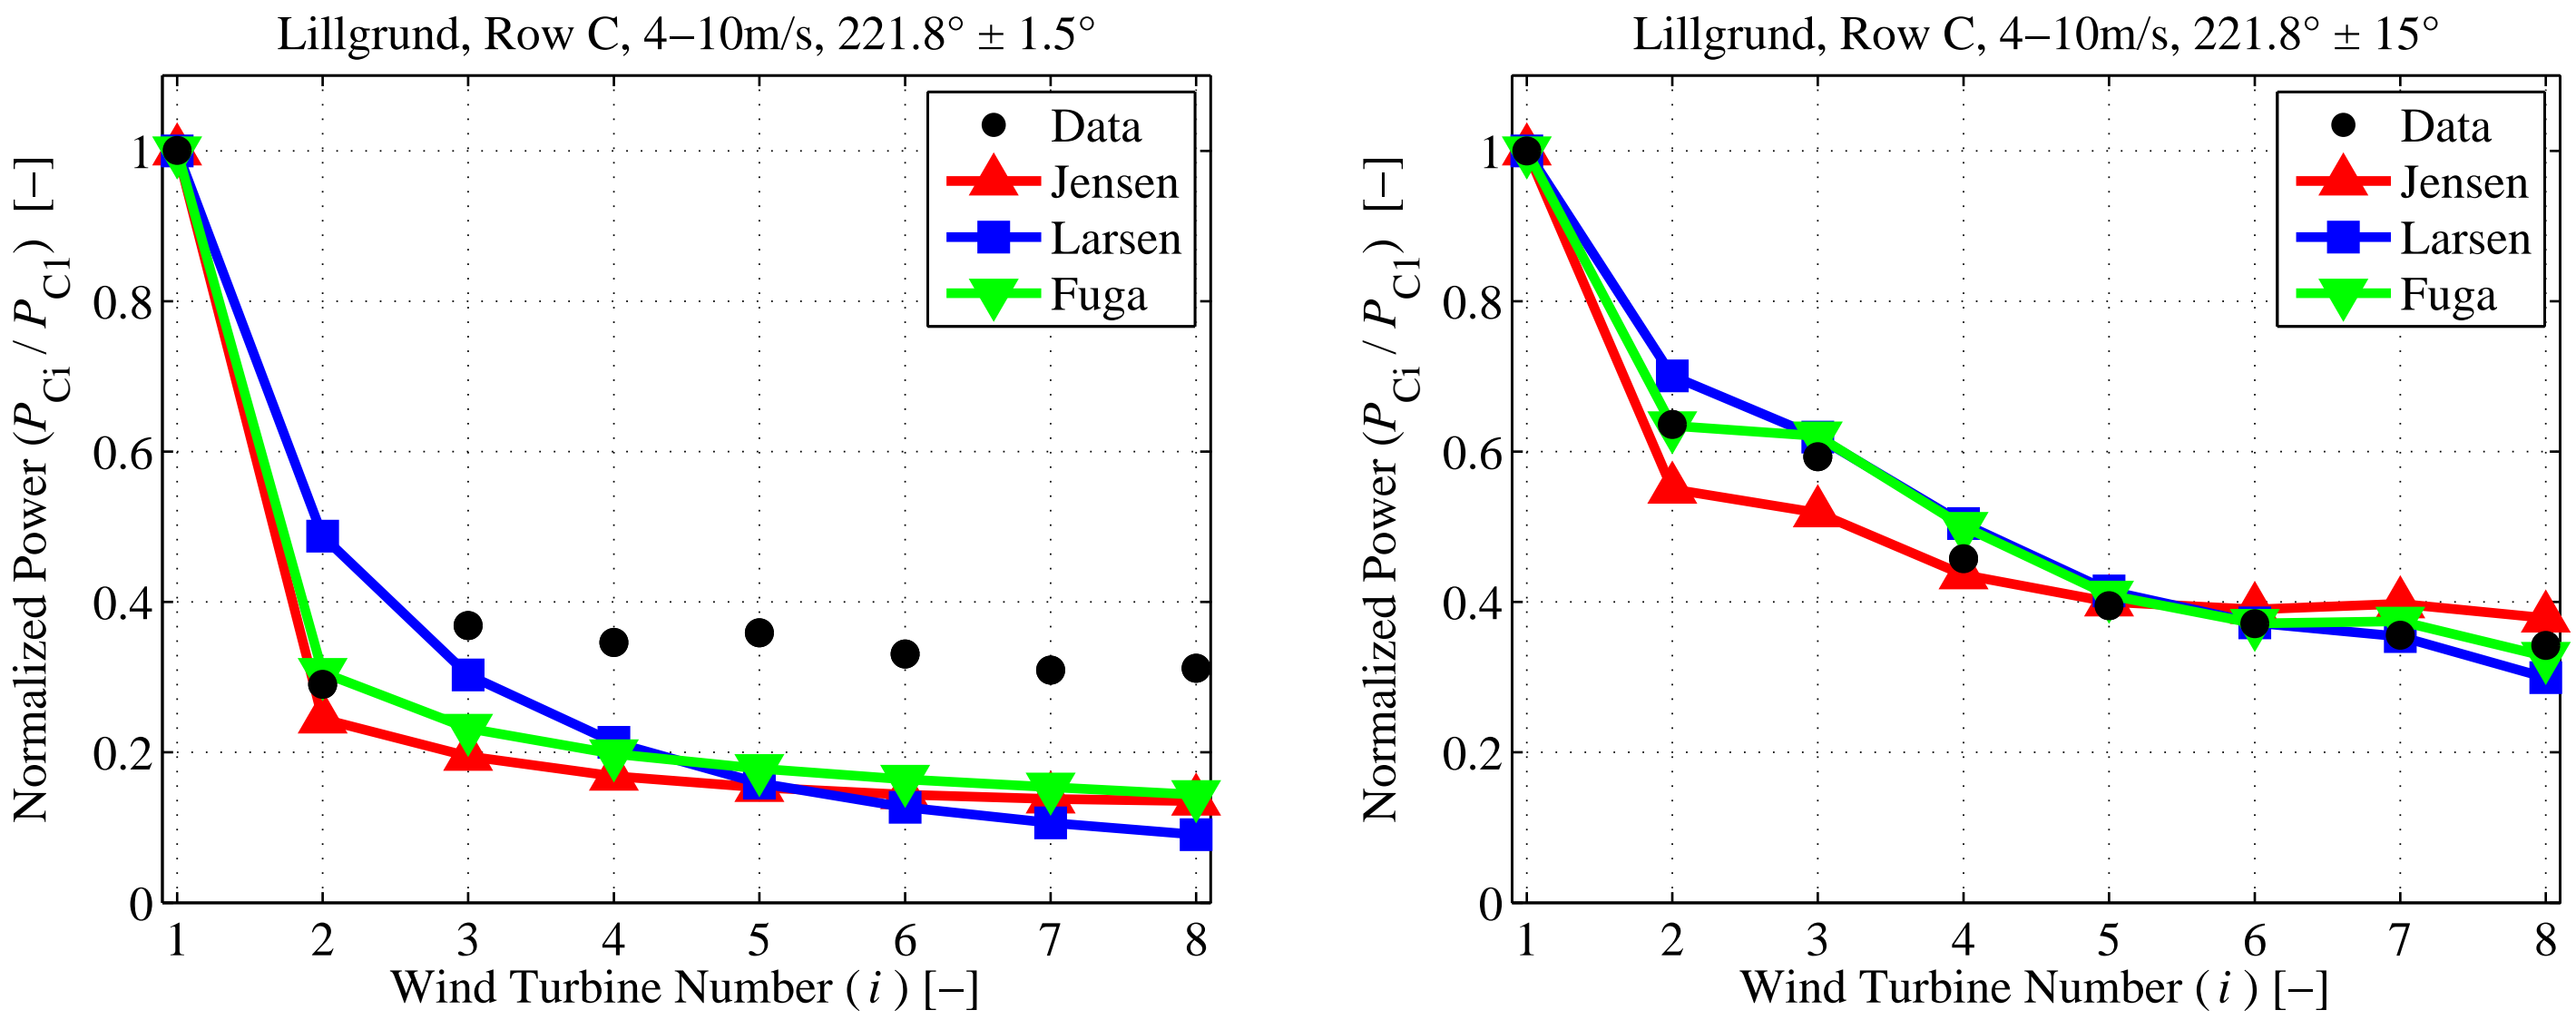


Figure 4: Normalized power in row C at Lillgrund for the wind direction sector 221.8° $\pm 1.5^\circ$ (left) and $\pm 15^\circ$ (right).

Discussion

The main sources of wind direction uncertainty in the datasets are the yaw misalignment of the reference wind turbine, the spatial variability of the wind direction within the wind farm and the variability of the wind direction within an averaging period. Filtering a dataset for narrow wind direction sectors of 3° and 5° therefore include situations where the turbines operate in conditions outside the span of the sector. This means that the turbines operate more often in wake free or partial wake situations (i.e. higher power outputs) than what is modelled by the numerical simulations. In turn, when the sector width increases the wind direction uncertainty becomes less significant and less cases are filtered in the wrong bins. The agreement in Fig. 3 and 4 for the 30° sectors is therefore improved because the simulations are more representative of the datasets.

Main conclusions

- ▶ The three wake models perform similarly at Horns Rev and Lillgrund although the turbine spacing and the turbulence intensity are different.
- ▶ The power predictions are accurate for wide directional sectors of 30°.
- ▶ The discrepancies for narrow wind direction sectors are caused by the wind direction uncertainty present in the datasets.